


WALL 12 TIGHT TO SLAB

FIRE RATED CSR HEBEL® WALL SYSTEM

DESCRIPTION	
1C	CSR Hebel® wall (minimum 75mm thick).
2	Lorient LVH44 intumescent fire damper.
3	Angles fixed to wall with steel masonry anchors at 150mm centres or at least 2 per side.
4	0.6mm (min) Z275 galvanised steel angles to all three sides Angle dimensions shall be continuous and at least 2 x the dimension of the gap between the damper casing and the penetrated element. Each angle fixed to damper casing with steel fasteners at 150mm centres or at least 2 per side.
5	Z275 galvanised steel casing min thickness 0.6mm.
6	Fire damper fixed to casing with 2 x steel screws (100mm centres).
7	Fire damper perimeter sealed with Lorient intumescent sealant.
8	Gap between casing and aperture filled full depth (at least 50mm depth) with Lorient intumescent sealant. Maximum annular gap between casing and wall is 25mm.
9	Casing terminates with breakaway joint as per AS1682.2.
10	100mm wide x 50mm thick TBA Firefly Intubatt or 100mm wide x 25mm thick non-combustible block running full width of aperture. Bedded in Lorient intumescent sealant and mechanically fixed to slab with steel expanding anchors.

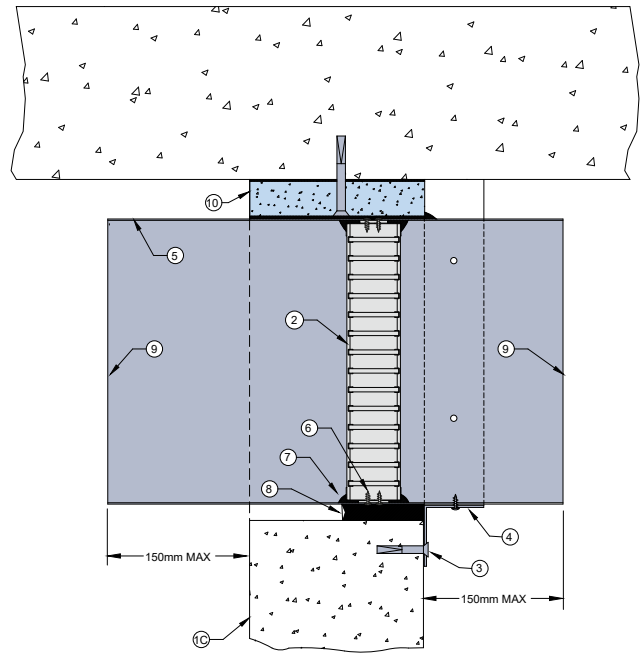

LVH44 in steel casing penetrating fire rated CSR Hebel® wall – tight to slab FRL -/120/30

Fire Resistance in accordance with

AS1530.4 2014

Approval Ref

EXOVA EWFA 33233400

Max size

600mm x 600mm

INSTALLATION INSTRUCTIONS

- ▶ Prepare the wall opening to accept the fire damper and install in wall, as shown in system detail.
- ▶ Non-combustible TBA Intubatt block is fixed to slab, as per point 10.
- ▶ Lorient intumescent sealant liberally applied to block and duct containing damper is positioned and pushed up tight to block.
- ▶ Firestop the gap between the casing and wall with Lorient intumescent sealant, note fill details in point 8.
- ▶ 3 off perimeter angles are mechanically fixed to bottom and sides of casing with steel self drilling screws and fixed to wall with masonry anchors, as detailed in point 3.
- ▶ Ductwork shall be connected with breakaway joints, as per point 9.
- ▶ Ensure product identification labels are conspicuously positioned for easy identification.
- ▶ Ensure convenient access is provided to allow for AS1851 inspection and maintenance routines.
- ▶ **Note: Fixings supplied by others.**